



Wonder Metals Corp. certifies that the louver model EXSDL-4 shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to air performance ratings and water penetration ratings only.



AMCA ratings seal applies to Air Performance and Water Penetration ratings tested in accordance with ANSI/AMCA 500-L Figure 5.5 -6.3



Published louver performance data bearing AMCA Certified Ratings Seal for Air Performance & Water Penetration must be submitted for approval prior to fabrication and must demonstrate pressure drop and water penetration equal to or less than WMC model specified.

		WIDTH																			
		12	18	24	30	36	42	48	54	60	66	72	78	84	90	96	102	108	114	120	
HEIGHT	12	0.27	0.45	0.62	0.79	0.96	1.14	1.31	1.48	1.66	1.83	2.00	2.17	2.35	2.52	2.69	2.87	3.04	3.21	3.38	
	18	0.45	0.74	1.02	1.31	1.60	1.88	2.17	2.17	2.74	2.93	3.21	3.50	3.79	4.07	4.36	4.64	4.93	5.22	5.50	
	24	0.68	1.11	1.54	1.97	2.40	2.83	3.26	3.69	4.12	4.55	4.98	5.41	5.84	6.27	6.70	7.13	7.56	7.99	8.42	
	30	0.90	1.47	2.04	2.61	3.18	3.75	4.32	4.89	5.46	6.03	6.59	7.16	7.73	8.30	8.87	9.44	10.01	10.58	11.15	
	36	1.11	1.80	2.50	3.20	3.90	4.59	5.29	5.99	6.69	7.39	8.08	8.78	9.48	10.18	10.88	11.57	12.27	12.97	13.67	
	42	1.32	2.15	2.98	3.81	4.64	5.48	6.31	7.14	7.97	8.80	9.63	10.47	11.30	12.13	12.96	13.79	14.62	15.46	16.29	
	48	1.54	2.51	3.48	4.45	5.42	6.39	7.18	8.32	9.30	10.38	11.44	12.50	13.56	14.62	15.68	16.74	17.80	18.86	19.92	
	54	1.76	2.86	3.97	5.08	6.19	7.30	8.41	9.51	10.62	11.73	12.84	13.95	15.06	16.16	17.27	18.38	19.49	20.60	21.71	
	60	1.98	3.24	4.49	5.74	7.00	8.25	9.50	10.76	12.01	13.26	14.52	15.77	17.02	18.28	19.53	20.78	22.04	23.29	24.54	
	66	2.20	3.58	4.97	6.36	7.74	9.13	10.51	11.90	13.29	14.67	16.06	17.45	18.83	20.22	21.61	22.99	24.38	25.77	27.15	
	72	2.40	3.91	5.42	6.94	8.45	9.96	11.48	12.99	14.50	16.02	17.53	19.05	20.56	22.07	23.59	25.10	26.61	28.13	29.64	
	78	2.60	4.25	5.89	7.54	9.18	10.83	12.47	14.12	15.76	17.41	19.05	20.69	22.34	23.98	25.63	27.27	28.92	30.56	32.21	
84	2.86	4.66	6.47	8.27	10.07	11.88	13.68	15.49	17.29	19.10	20.90	22.71	24.51	26.31	28.12	29.92	31.73	33.53	35.34		
90	3.04	4.96	6.88	8.80	10.72	12.64	14.57	16.49	18.41	20.33	22.25	24.17	26.09	28.01	29.93	31.85	33.77	35.69	37.61		
96	3.28	5.36	7.43	9.50	11.57	13.64	15.72	17.79	19.86	21.93	24.01	26.08	28.15	30.22	32.30	34.37	36.44	38.51	40.59		
102	3.50	5.71	7.92	10.13	12.34	14.55	16.76	18.97	21.18	23.39	25.60	27.81	30.02	32.23	34.44	36.66	38.87	41.08	43.29		
108	3.73	6.09	8.45	10.81	13.17	15.52	17.88	20.24	22.60	24.95	27.31	29.67	32.03	34.39	36.74	39.10	41.46	43.82	46.18		
114	3.96	6.45	8.95	11.45	13.95	16.45	18.95	21.44	23.94	26.44	28.94	31.44	33.94	36.43	38.93	41.43	43.93	46.43	48.93		
120	4.16	6.78	9.41	12.03	14.66	17.28	19.91	22.53	25.16	27.78	30.40	33.03	35.65	38.27	40.90	43.52	46.14	48.77	51.39		

Free Area Chart

AMCA Standard 500 provides a reasonable basis for testing and rating louvers. Testing to AMCA 500 is performed under a certain set of laboratory conditions. This does not guarantee that other conditions will not occur in the actual environment where louvers must operate.

The louver system should be designed with a reasonable safety factor for louver performance. To ensure protection from water carryover, design with a performance level somewhat below maximum desired pressure drop and .01 oz./sq. ft. of water penetration.

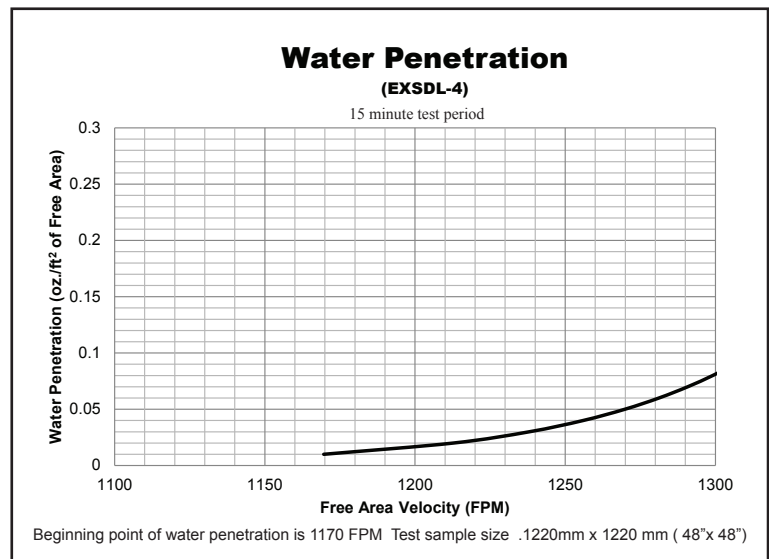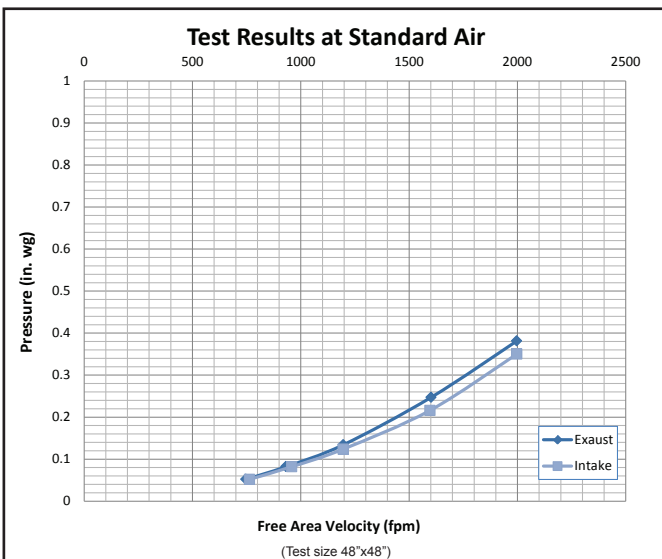

Wonder Metals certifies that WMC model EXSDL-4 is licensed to bear the AMCA seal. The ratings shown are based on test and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA certified ratings